



Technical data

Operating voltage 24V AC/DC±10 %
 Power consumption <8 mA
 Weight ca. 75g
 Contacting connecting terminals on the housing
Type FGO 2.K/5
 Measuring range (0...10 V) 50...100%rh
 Accuracy (MR 50...95%rh, at 23°C) ±2%rh
 Output signal 0...10V
 Response time (at calm air) < 20 s

Type FGS 02.K/5

Switching point (factory setting)
 „off“ (contact „open“) ≥96 ±2%rh
 „on“ „off“-4%rh ±1%rh
 Output floating contact
 Voltage max. 48V
 Switching current max. 0.5A
 Switching power max. 10W

Type FGS 02.K/6



Switching point (factory setting)
 „on“ (contact „closed“) ≥90 ±2%rh
 „off“ „on“-4%rh ±1%rh
 Output floating contact
 Voltage max. 48V
 Switching current max. 0.5A
 Switching power max. 10W
 Temperature application range FGO -20...+80°C
 FGS 0...+70°C

„Technical modification rights reserved“

Installation drawing

Mounted on:


... pipes

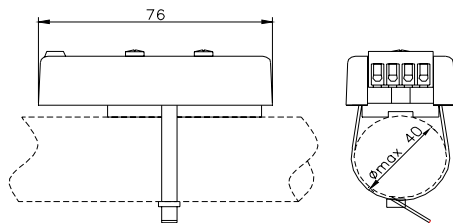

The electrical connection must only be carried out by properly qualified personnel.

...smooth surfaces

(Mounting-Kit ZA30)



Adhesive strips Heat conductivity paste

Humidity sensors for condensation control

- analogue output signal type FGO 2.K/5
- switching output (break contact) type FGS 02.K/5
- switching output (make contact) type FGS 02.K/6

Description

Dew-point control sensors are mounted on cooling water pipes or on cooled surfaces and are used to monitor if the temperature drops below the dew-point.

They measure the relative humidity directly on the surface of the cooled part of the equipment and can, therefore, be used

- to influence cooling power
- to switch cooling systems on or off
- to signal the point at which the temperature drops below the dew-point.

This means that cooling ceilings, for example, can be operated with perfect results, even at critical climatic values, without condensation starting to form.

User instructions

The sensors are to be mounted in the place where condensation is most likely to form, on the polished metal pipe using cable binders or on a smooth surface which must be clear of grease and be dry using the **ZA 30-type mounting kit** (product info sheet no. F 5.1) which is available as an accessory.

Ensure that there is good thermal contact between the pipe or the surface and the humidity sensor.

The installation position is to be selected in such a way that a representative measurement of the air humidity will be given, i.e. the ambient air must be able to reach the measuring element within the casing without obstacles. The condensation controller should be exposed to the flow of air. The sensors come ready-calibrated and, consequently, do not need to be adjusted on-site.

Please consult the **application instructions for the sensing elements** (product info sheet no. A 1) or check with the manufacturer for further information which you need to bear in mind when using humidity sensors with capacitive sensing elements.

Order designations

Type	FGSO2.K/5	FGSO2.K/6	FGO2.K/5
Order no.	42FGSO2.K/5	42FGSO2.K/6	45FGO2.K/5

ATTENTION! Sensors FGO2.K/5 have no galvanical separation between output and operating voltage at the negative pole. Please pay attention to this fact when connecting an AC-operating voltage

Pin connections

supply	clamp	FGSO2.K/5	FGSO2.K/6	FGO2.K/5
24 V AC/DC ±10%	1	- (~)	- (~)	- (~)
	2	+ (~)	+ (~)	+ (~)
output		contact	contact	analogue
	3	break contact	make contact	+ 0..10V
	4			- 0..10V
switching point		96%rh	90%rh	50...100%rh

This information is based on current knowledge and is intended to provide details of our products and their possible applications. It does not, therefore, act as a guarantee of specific properties of the products described or of their suitability for a particular application. It is our experience that the equipment may be used across a broad spectrum of applications under the most varied conditions and loads. We cannot appraise every individual case. Purchasers and/or users are responsible for checking the equipment for suitability for any particular application. Any existing industrial rights of protection must be observed. The perfect quality of our products is guaranteed under our General Conditions of Sale. Issue: July 2004. Subject to modifications.